



## RECOMMENDATIONS

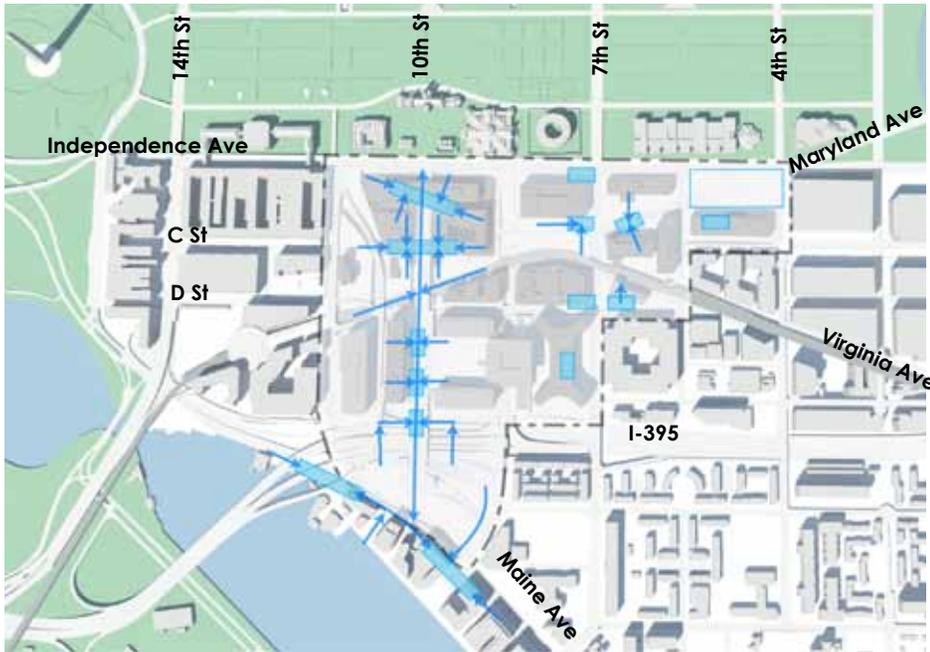

DISTRICT-SCALE WATER SYSTEMS

Water Storage   
 Water Collection 

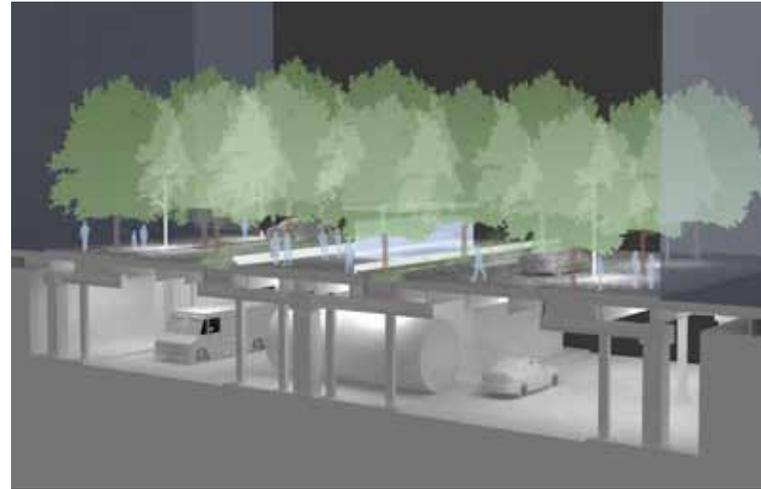

(Above) - Potential stormwater storage (tank or cistern) under 10th Street, SW

### DISTRICT-SCALE

- › All stormwater and greywater will be sent to cisterns under 10th Street, SW. Reuse of this water in buildings and landscapes could provide 71 percent of the total water used in the Ecodistrict. It could also provide a free water source to the central utility plant (described in the Energy Section), which uses significant amounts of potable water annually.
- › Blackwater and greywater strategies are important for meeting the area's potable water reduction goals. In this regard 40 percent of the non-potable water is to be sourced from waste water and 27 percent from stormwater. In so doing, potable water use can be reduced by 63 percent and stormwater runoff can be eliminated.